

- PLUMBING PLAN NOTES:**
- CONNECT TO CAPPED C.W. FEED FOR TENANT.
  - PROVIDE OFF-SET DWV AND WATER TO SINK
  - PROVIDE ROUGH-IN FOR RESIDENTIAL STYLE DISHWASHER. CONNECT DRAIN TO DRAIN YOKE AT SINK DRAIN. PROVIDE SYMONS S-23-3 FAUCET IN LIEU OF SPECIFIED P-5 FAUCET
  - PROVIDE SIZE 'A' SHOCK AT C.W. DROP TO FLUSH VALVE FIXTURE.
  - STANDPIPE DW & V. COORDINATE ROUGH-IN W/EQUIPMENT SUPPLIER.
  - CONNECT C.D. (CONDENSATE DRAIN) LINE TO C.D. STACK
  - INSTALL 2 INCH PIPING BETWEEN GENERATOR REMOTE FILL STATION AND GENERATOR AND MAKE CONNECTIONS. COORDINATE INSTALLATION REQUIREMENTS WITH GENERATOR SUPPLIER. PIPING TO BE ASTM A53 OR ASME B36.10 SCHEDULE 40 BLACK STEEL WITH THREADED OR WELDED JOINTS. CONFORM TO NFPA 30.


- A/S SYSTEM DESIGN INTENT NOTES:**
- EXISTING SHELL BUILDING IS PROVIDED WITH COMPLETE A/S SYSTEM COVERAGE FOR THE ENTIRE BUILDING AS PER REQUIREMENTS OF N.F.P.A. 135, 2009 EDITION.
  - SPRINKLER CONTRACTOR SHALL RENOVATE/REWORK EXISTING A/S SYSTEM TO PROVIDE COMPLETE A/S SYSTEM PROTECTION FOR THE TENANT IN-FILL.
  - SPRINKLER DESIGN DENSITY AS FOLLOWS:  
LIGHT HAZARD
  - PROVIDE QUICK RESPONSE SPRINKLERS THROUGHOUT THE TENANT IN-FILL AREA.  
A. WHITE RECESSED PENDENT HEADS IN ALL AREAS WITH FINISHED CEILINGS.  
B. BRASS UP-RIGHT HEADS IN ALL AREAS WITH UNFINISHED CEILINGS.
  - DO NOT ROUTE SPRINKLER FEED BULK MAIN OR CROSS MAIN ABOVE ELEC. ROOMS.
  - SPRINKLER PIPING TO BE:  
2" & SMALLER - SCH. 40 STEEL  
2 1/2" & LARGER - SCH. 10 THINWALL
  - PLANS FOR MODIFICATIONS TO THE EXISTING FIRE SPRINKLER SYSTEM MUST BE SUBMITTED TO THE CITY OF ATHENS FIRE DEPARTMENT FOR REVIEW AND APPROVAL PRIOR TO MAKING ANY CHANGES TO THE A/S SYSTEM.

**WALL LEGEND**

GYP. BD.	CMU	WALL CONSTRUCTION TYP.
---	---	EXISTING PARTITION
---	---	UNRATED PARTITION TO ABOVE CLG.
---	---	UNRATED PARTITION TO DECK
---	---	LEASE SPACE PARTITION
---	---	ONE HOUR FIRE PARTITION
---	---	ONE HOUR FIRE - SMOKE PARTITION
---	---	TWO HOUR FIRE PARTITION
---	---	TWO HOUR FIRE - SMOKE PARTITION
---	---	ONE HOUR SHAFT WALL
---	---	FOUR HOUR FIRE WALL

NOTE: 1.) FOR SOUND WALLS SEE DIMENSIONED PLAN.  
2.) ALL WALL TYPES MAY NOT BE USED.

SURGERY CENTER OF ATHENS  
AT  
ATHENS MEDICAL PLAZA I  
2142 WEST BROAD STREET  
ATHENS, GEORGIA

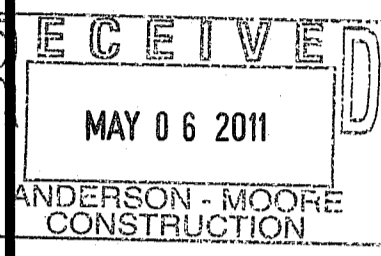

THE CONTRACTOR ASSUMES ALL RESPONSIBILITY FOR THE ACCURACY OF THE INFORMATION THAT IS PROVIDED TO DAVIS, STOKES COLLABORATIVE, P.C. IN THIS DOCUMENT AND/OR ITS CONTENTS. ANY AND ALL INFORMATION CONTAINED HEREIN IS THE PROPERTY OF DAVIS, STOKES COLLABORATIVE, P.C. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE PRIOR WRITTEN PERMISSION OF DAVIS, STOKES COLLABORATIVE, P.C. ALL RIGHTS RESERVED.

**DAVIS · STOKES COLLABORATIVE, P.C.**  
A · R · C · H · I · T · E · C · T · S  
7121 CROSSROADS BLVD. BRENTWOOD, TENNESSEE 37027  
TEL: 615-726-0010 FAX: 615-726-2090  
http://www.dsccol.com EMAIL: dsccol@dsccol.com

**REVISION**

NO.	DATE	DESCRIPTION
1	04/18/11	REVISION #1
2	05/05/11	REVISION #2

**PLUMBING FLOOR PLAN**

